


POWER GENERATION

Heat Transfer from Reactor to Coolant

$$\begin{aligned}
 P_{Rx} &= \dot{m} (h_{rx-out} - h_{rx-in}) \\
 &= \dot{m} c_p (T_{cool-out} - T_{cool-in}) = \dot{m} c_p \Delta T \quad [PWRs \text{ only!}]
 \end{aligned}$$



Mass Flow Rate


$$\dot{m} = \rho_{cool} A_{flow} v_{cool}$$

Thermal Efficiency (η_{th})

$$\eta_{th} = \frac{P_{elect} \text{ [MWe]}}{P_{Rx} \text{ [MWt]}} = 1 - \frac{Q_{cond}}{P_{Rx}}$$

Condenser (Waste) Heat Rejection

$$Q_{cond} = P_{Rx} (1 - \eta_{th}) = P_{elect} \left(\frac{1}{\eta_{th}} - 1 \right)$$

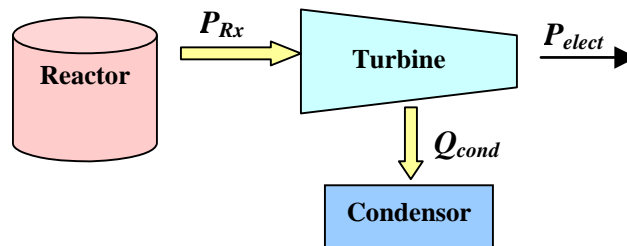

Capacity Factor (CF)

$$CF = \frac{\text{Total energy generated over time period}}{(\text{Plant rating})(\text{Time period})} = \frac{\int_0^T P_e(t) dt}{P_{e,max} T}$$

Availability Factor (AF \geq CF)

$$AF = \frac{\text{Integrated electrical energy output capacity}}{\text{Total rated energy capacity for period}}$$